


# Summary Report

Serial Number 000071140  
 Logger Name Engel Run 2

First Reading 6:24:20 PM 9/11/2018  
 Last Reading 7:53:20 PM 9/12/2018  
 Elapsed Time 1d, 1h, 29m  
 Total Readings 1530

Alarm *Not Set*  
 Logging Rate 1 Minute

Fahrenheit	Low Alarm	Not Set	High Alarm	Not Set
Minimum <b>34.0°F</b> 9:58:20 PM 9/11/2018	Alarm Occurrences N/A	●	Alarm Occurrences N/A	●
Maximum <b>84.0°F</b> 6:24:20 PM 9/11/2018	Total time in alarm N/A		Total time in alarm N/A	
Average Reading <b>35.99°F</b>	First Alarm Triggered N/A		First Alarm Triggered N/A	
Standard Deviation <b>5.91°F</b>	Longest Alarm N/A		Longest Alarm N/A	
Mean Kinetic Temperature <b>36.00°F</b> ( $\Delta H83.14472$ )				

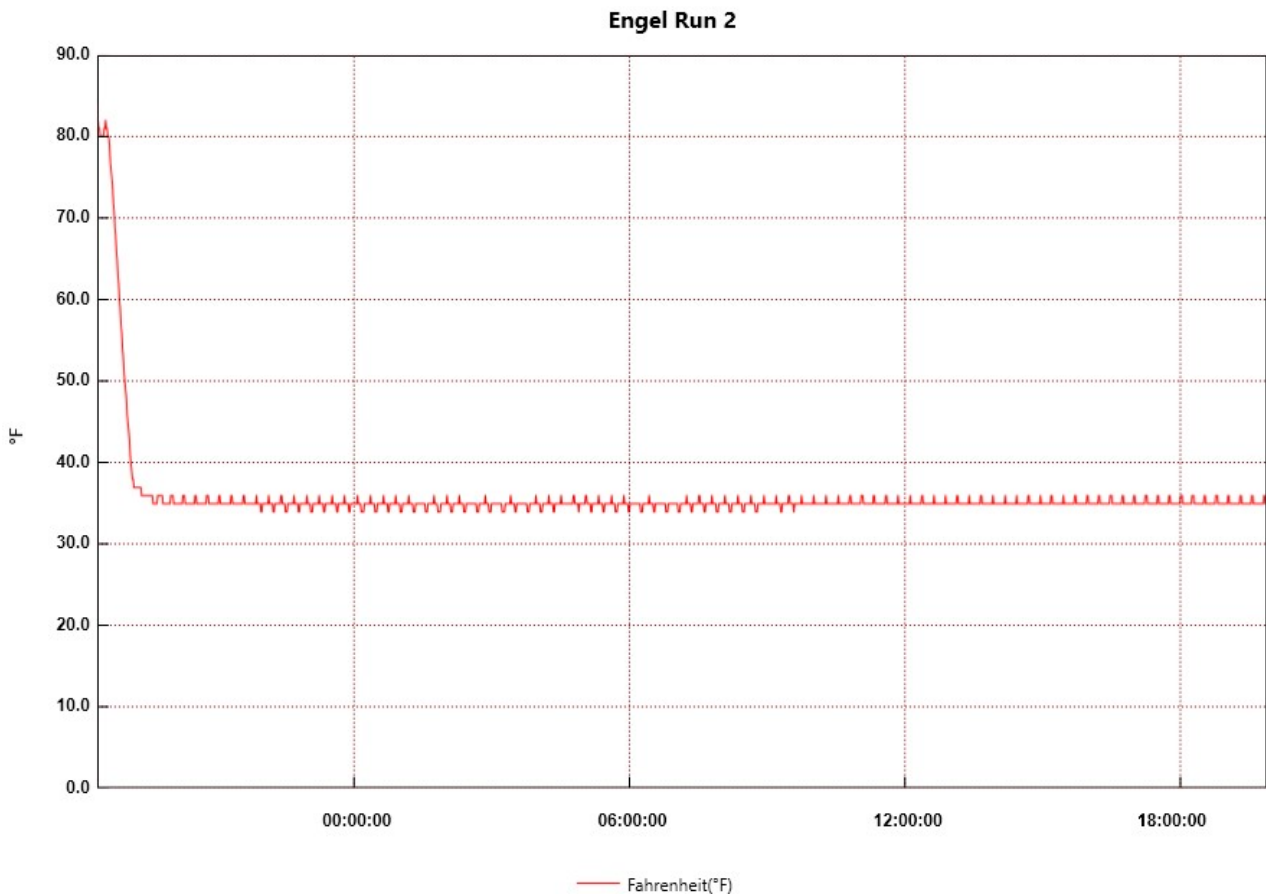

From: Tuesday, September 11, 2018 6:24:20 PM - To: Wednesday, September 12, 2018 7:53:20 PM